



Schedule 2
Land Zoning Map

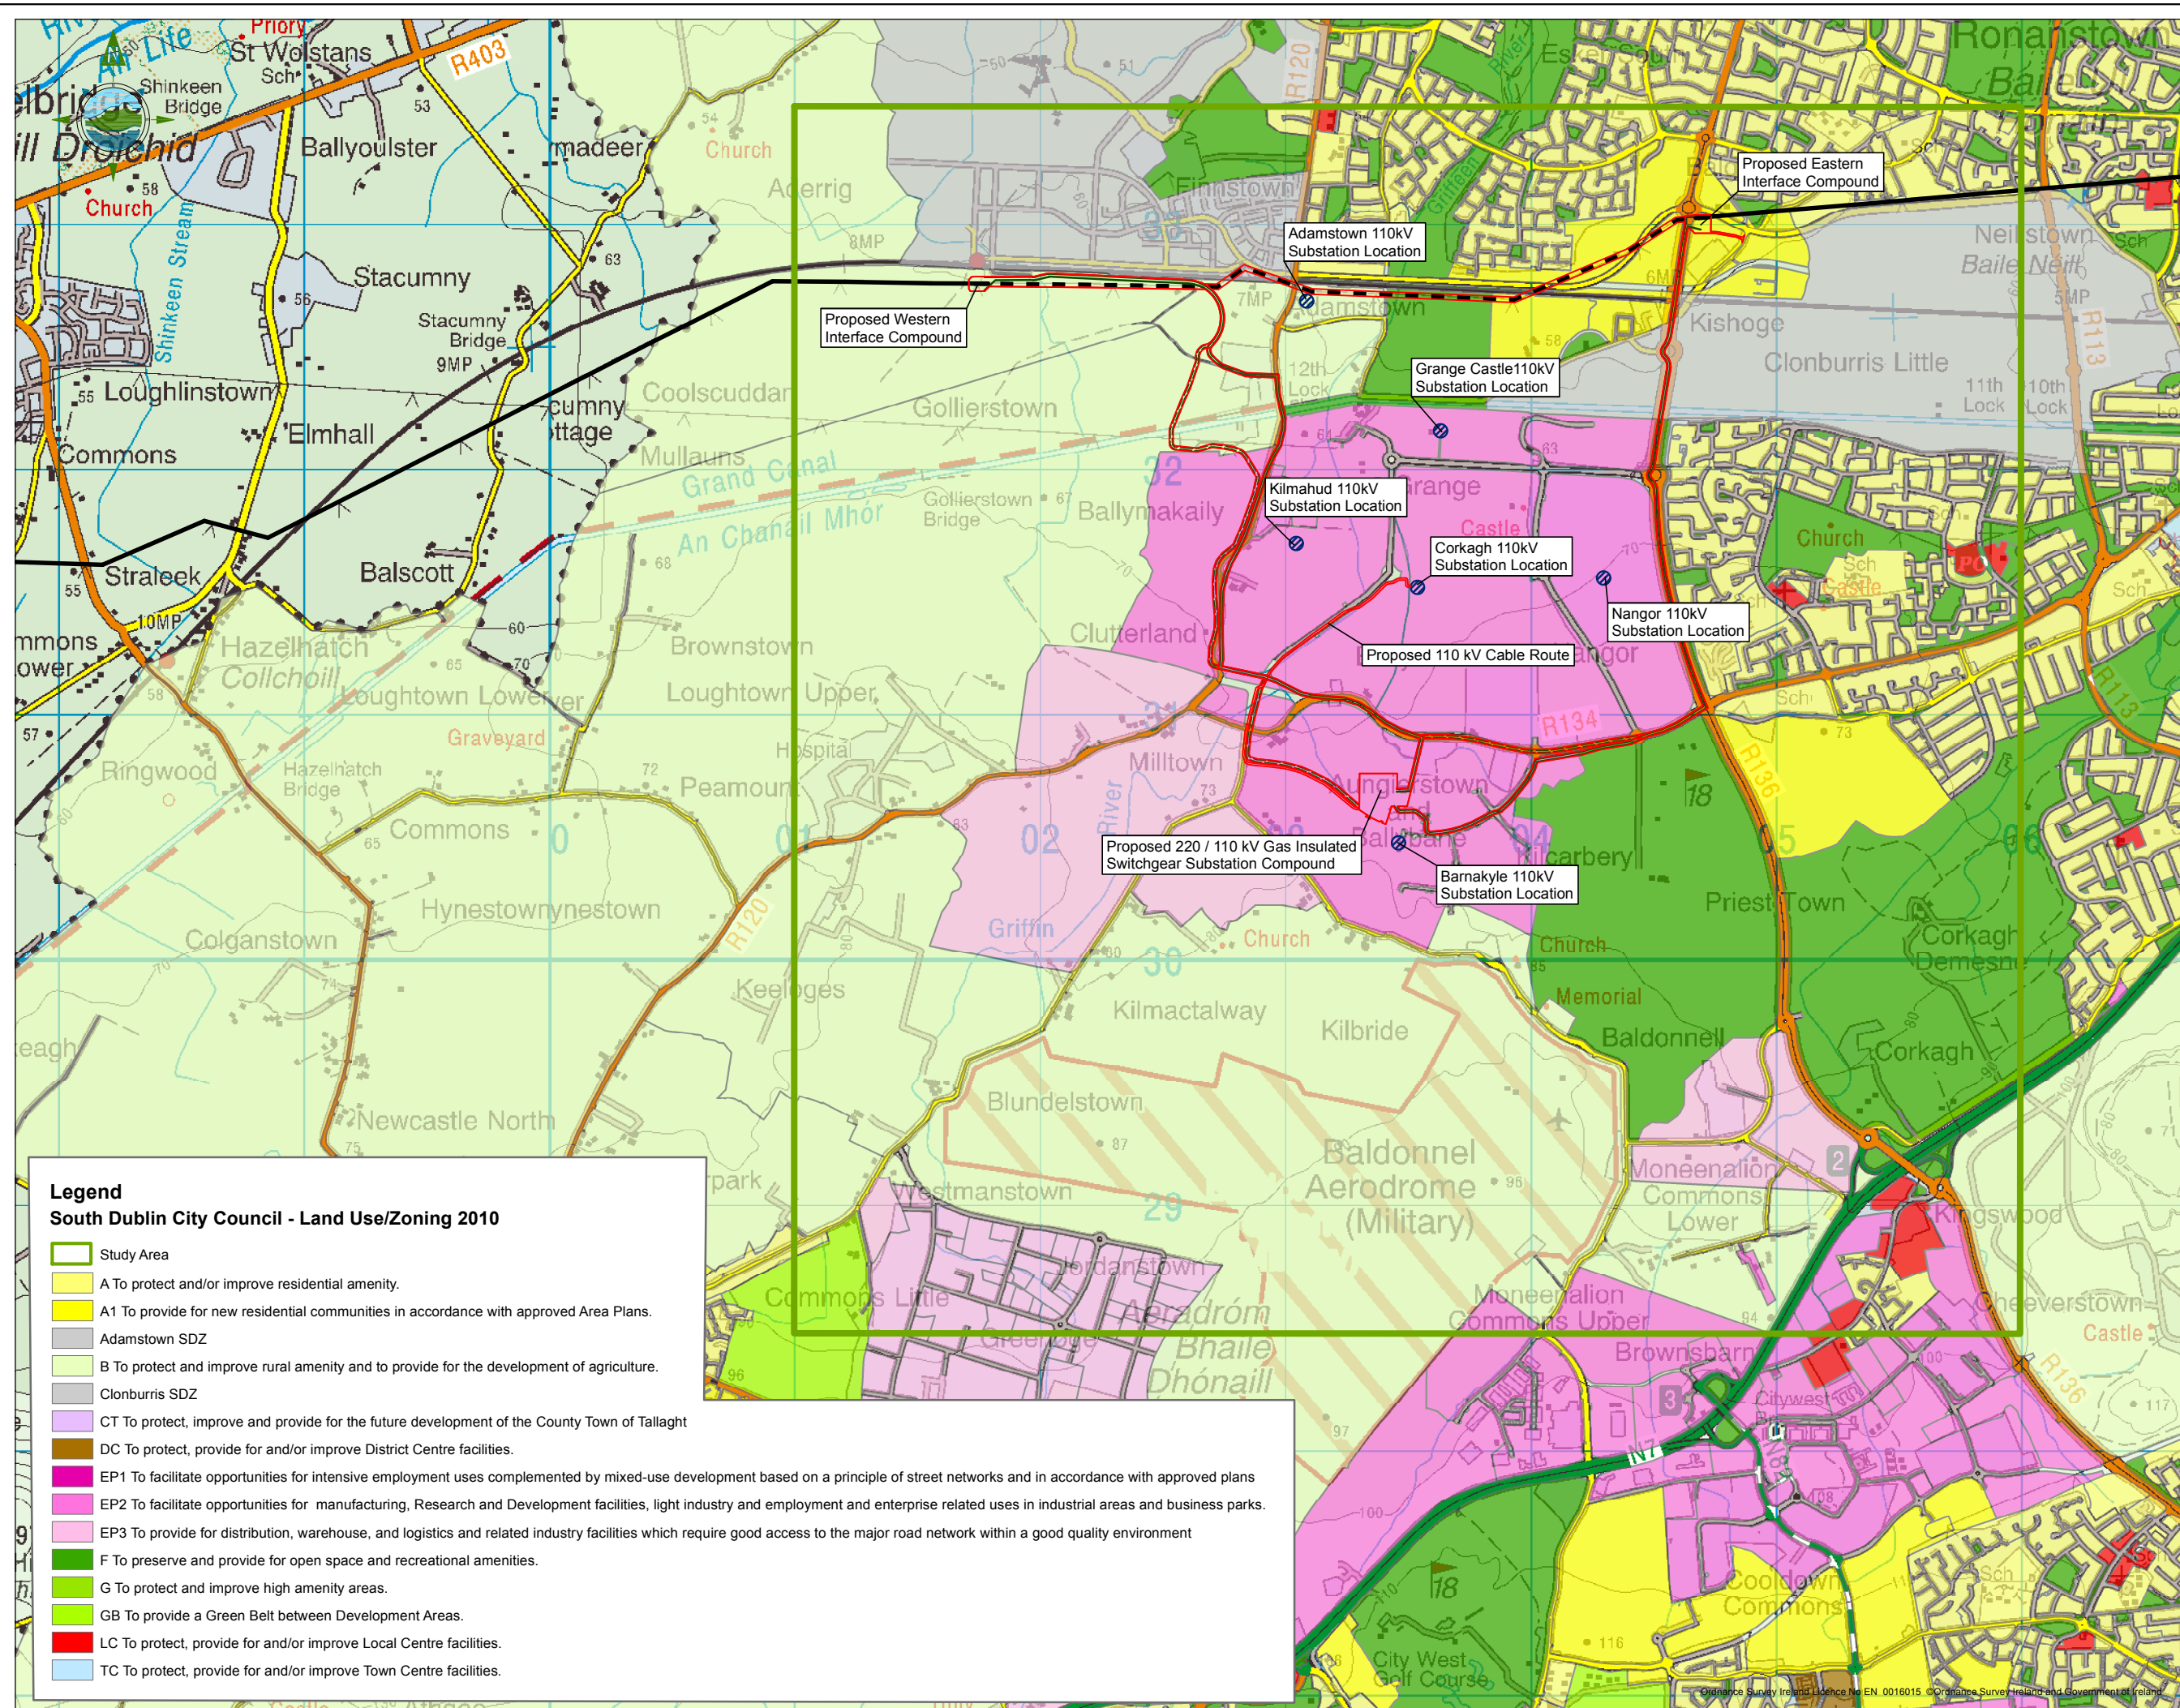

Legend

- 220kV Line
- Length of 220kV line to be removed
- Planning Application Boundary
- Preferred 220 kV Double Circuit Route Corridor
- Alternative 220 kV Double Circuit Route Corridor
- Existing / Proposed Substation Location



- NOTES
- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING
 - ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE
 - ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES
 - ALL LEVELS RELATE TO ORDNANCE SURVEY DATUM AT MALIN HEAD

A	DEC-2015	Issued	G.F.	A.A.
Issue	Date	Description	By	Chkd.

Client: **EIRGRID**

Project: **West Dublin 220/110 kV Substation and Associated Works**

Title: **Land Zoning**

Scale @ A3: 1:25,000

Prepared by: G.Fil Checked: A.Austin Date: November 2015
Project Director: D.Grehan

TOBIN Consulting Engineers
Consulting, Civil and Structural Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: info@tobin.ie
www.tobin.ie